

AEL8 Series Safety Information

Quick Start Guide

Caution

Before commencement of any work to make the electrical connections refer to IM-P714-02 for the AEL8 Section 1 "Safety Information".

IM-P714-02 can be found on the Spirax Sarco website.

Warning

Mains connection and commissioning of the AEL8 Series actuator requires specialist knowledge of electrical circuits and systems, and the inherent dangers. A working knowledge of linear actuators is also required. The operator is responsible for ensuring that safe systems of operation and practice are implemented and maintained.


Only qualified personnel must be allowed to make the electrical power connections to the AEL8 Series actuator, and these personnel must be familiar with, and comply with the applicable health and safety standards or guidelines.

Failure to do so could result in death, severe physical injuries or material damages to the actuator, valve and associated equipment.

- Ensure that the electrical power supply is isolated.
- Safeguard against the unintentional switching on by ensuring that there is a safe system of practice in operation – e.g. lock off the electrical supply isolator.
- Ensure that any installation of any new power supply is compliant with local regulations
- Check the mains connection voltage and frequency for conformity to the actuator. Details of the requirements are identified on the AEL8 Series actuator nameplate which can be found on the actuator baseplate.
- Ensure that the power supply cable is of the correct cross section for the maximum expected load. Details of the requirements are identified on the AEL8 Series actuator nameplate which can be found on the actuator baseplate, and in the Technical Information Sheet (TI-P714-01).
- Minimum cross section for the power supply cable is 1 mm². Conductors below this area can result in operational disturbances.
- Ensure that the power supply is correctly fused for the maximum expected load. Details of the requirements for each AEL8 Series actuator can be found in TI-P714-01.

Information

Terminal diagram can be found inside the cover of the actuator

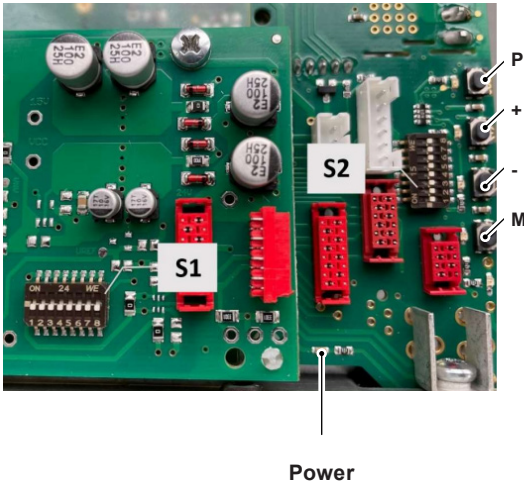

Push button assignment

P	Programming button / Save button
+	Movement retracting (to open valve)
-	Movement extracting (to close valve)
A	Switchover MANUAL/AUTO

LED assignment

L_P	Orange
L_+	Red
L_-	Green
L_A	Blue
L_Power	Green LED showing PCB is powered

DIP switches

S1	DIP switch row S1
S2	DIP switch row S2

Starting auto tune function

For the majority of applications a quick set-up routine can be adopted. With the actuator spindle in the fully extended position, the power supply safely isolated and the actuator cover removed:

- With reference to Tables on page 30 in IM-P714-02 (DIP Switch Configuration)
- Select the action required with S1.2 (default is actuator stem extended at minimum input signal)
- Ensure S1.1 is "Off"
- Select the control signal required with S1.5 (default is 4-20 mA / 2-10V)

Note: the feedback signal from the positioner automatically updates to the chosen input signal

- Select the desired failure mode(s) in the event of control signal and power supply interruption. For Steam systems, it is recommended that DIP Switches S1.7, S1.8, S2.5 and S2.6 be set to "OFF" (Tables on page 33 IM-P714-02)
- Manually move the valve off its seat approximately 20-50%



Warning

The AUTOTUNE function will cause the valve and actuator to move. Make certain that all outcomes have been properly accounted for. The AUTOTUNE function can be stopped by pressing and holding any button during the commissioning cycle.

Warning

Prior to commissioning actuators fitted with the Shutdown Module, it is important to refer to Section 6.7: Commissioning of Shutdown Module

- Reconnect power supply
- Set S2.8 to "ON" and the PROG LED will flash
- Press and hold PROG button for 3 seconds, AUTOTUNE will commence

Commissioning LED status

LED				Status
BLUE	RED	GREEN	ORANGE	
			Flash	Waiting for AUTOTUNE start
	Flash (alternate)		Flash	AUTOTUNE in progress
		Flash		AUTOTUNE complete
	Quick Flash			AUTOTUNE error

- Once AUTOTUNE is complete the illuminated hand wheel will also confirm actuator status (Green if control signal is connected.)
- Set S2.8 to "OFF"

Illuminated Hand Wheel – Actuator status

Colour of handwheel	Status
GREEN	Ready for operation
BLUE	Manual operation (Handwheel engaged)
ORANGE	Warning (e.g. actuator operating at 50% speed)
RED	Fault

For manual commissioning and DIP switch configuration please refer to IM-P714-02

DECLARATION OF CONFORMITY

Apparatus model/Product: Electric Linear Actuators: AEL8 Series

Name and address of the manufacturer or his authorised representative:

Spirax Sarco Ltd,
Runnings Road
Cheltenham
GL51 9NQ
United Kingdom

This declaration of conformity is issued under the sole responsibility of the manufacturer.

The object of the declaration described above is in conformity with the relevant statutory requirements of:

SI 2016 No.1101 • The Electrical Equipment (Safety) Regulations 2016

SI 2016 No.1091 • The Electromagnetic Compatibility Regulations 2016

SI 2008 No.1597 • The Supply of Machinery (Safety) Regulations 2008
(Annex I clauses) 1.1.2, 1.1.3, 1.1.5, 1.2.1, 1.2.2, 1.2.6, 1.3.1, 1.3.2, 1.3.7, 1.5.1, 1.7.3, 1.7.4

(*As amended by EU Exit Regulations)

References to the relevant designated standards used or references to the other technical specifications in relation to which conformity is declared:

SI 2016 No.1101 • EN 61010-1:2010+A1:2019
EN IEC 61010-2:2021

SI 2016 No.1091 • EN 61800-3:2004+A1:2012

SI 2008 No.1597 • EN ISO 12100:2010

Additional information:

Signed for and on behalf of: Spirax Sarco Ltd,
(signature):

(name, function): N Morris
(place and date of issue): Compliance Manager, Steam Business Development Engineering
Cheltenham
30 June 2023

GNP252-UK-C Issue 1

EU DECLARATION OF CONFORMITY

Apparatus model/Product: Electric Linear Actuators: AEL8 Series

Name and address of the manufacturer or his authorised representative:

Spirax Sarco Ltd,
Runnings Road
Cheltenham
GL51 9NQ
United Kingdom

This declaration of conformity is issued under the sole responsibility of the manufacturer.

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

2014/53/EU Low Voltage Directive

EMC Directive

2006/42/EC Machinery Directive
(Annex I clauses) 1.1.2, 1.1.3, 1.1.5, 1.2.1, 1.2.2, 1.2.6, 1.3.1,
1.3.2, 1.3.7, 1.5.1, 1.7.3, 1.7.4

References to the relevant harmonised standards used or references to the other technical specifications in relation to which conformity is declared:

(Low Voltage Directive) EN 61010-1:2010+A1:2019

EN IEC 61010-2:2021

(EMC Directive) EN 61800-3:2004+A1:2012

(Machinery Directive) EN ISO 12100:2010

Signed for and on behalf of: Spirax Sarco Ltd,
(signature):

(name, function): N Morris
(place and date of issue): Compliance Manager, Steam Business Development Engineering
Cheltenham
2023-06-30

GNP252-CE-C Issue 1