

TI-P110-02 CMGT Issue 9

Description


The SIB45 is an all stainless steel sealed inverted bucket steam trap. It is provided with pressure change assemblies for pressure differentials between 0.5 and 45 bar (7 and 65 psi). Traps for 45 bar (65 psi) are provided with an in-built check valve as standard.

Standards

This product fully complies with the requirements of the European Pressure Equipment Directive 2014/68/EU.

Certification


This product is available with certification to EN 10204 3.1 **Note:** All certification/inspection requirements must be stated at the time of order placement.

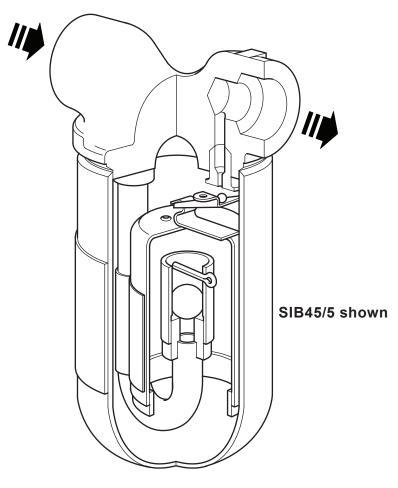

Sizes and pipe connections

SIB45/5


DN20 and DN25 (¾" and 1") Butt weld ends ANSI B 16.5 (to suit ANSI B 36.10 Schedule 80 pipe). Socket weld ends BS 3799 Class 3000 and ANSI B16.11. Standard flanges DIN 2547 PN100 and ANSI 600. SIB45/6, SIB45/8, SIB45/10 %" and 1" screwed BSP T Rp (ISO 7-1) or NPT. DN20 and DN25 Standard flanges ANSI 150 and ANSI 300.

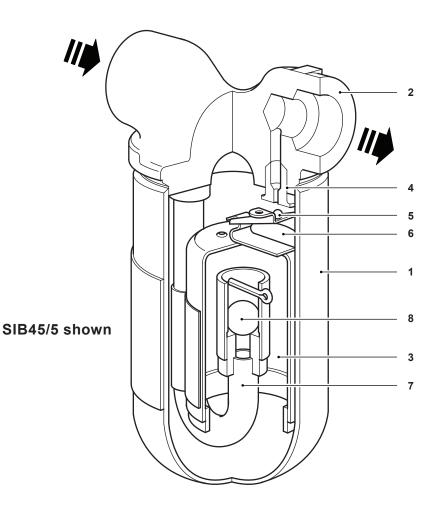

| No. | Part | Material | | | |
|-----|-------------------------------------|-----------------|--------------------|--|--|
| 1 | Cover | Stainless steel | ASTM A240 Gr. 304 | | |
| | Body | Stainless steel | ASTM A 182 F 304 | | |
| 2 | Pipes | Stainless steel | ASTM A 312 Gr. 304 | | |
| | Flanges * | Stainless steel | ASTM A 182 F 304 | | |
| 3 | Bucket | Stainless steel | | | |
| 4 | Valve seat | Stainless steel | | | |
| 5 | Valve | Stainless steel | | | |
| 6 | Valve lever | Stainless steel | | | |
| 7 | Internal tube | Stainless steel | | | |
| 8 | Check valve assembly (SIB45/5 only) | Stainless steel | | | |

* Note: For all flanges except: ¾" PN100 - ASTM A 182 F 316

Pressure/temperature limits

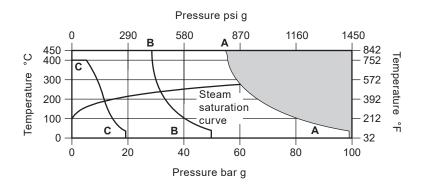


The product **must not** be used in this region.

A - A Screwed, butt weld, socket weld, flanged DIN 2547 PN100 and ANSI 600.

- B B Flanged ANSI 300.
- C C Flanged ANSI 150.

| Body design conditions | | | PN100 |
|--|----------------------------------|-------------------|----------------------|
| PMA Maximum allowable pressure | | 100 bar g @ 37 °C | 1450 psi g @ 98.6 °F |
| TMA Maximum allowable temperature | 9 | 450 °C @ 54 bar g | 842 °F @ 783 psi g |
| Minimum allowable temperature | | -254 °C | -425 °F |
| PMO Maximum operating pressure fo | r saturated steam service | 60 bar g | 870 psi g |
| TMO Maximum operating temperature | 3 | 450 °C @ 54 bar g | 842 °F @ 783 psi g |
| Minimum operating temperature | | 0 °C | 32 °F |
| Note: For lower operating temperatures | consult Spirax Sarco | | |
| | SIB45/10 | 4.5 bar | 65 psi g |
| ∆PMX Maximum differential pressure | um differential pressure SIB45/6 | | 290 psi g |
| | SIB45/5 | 45.0 bar | 653 psi g |
| Product is safe for use under full vacuu | n conditions | | |
| Designed for a maximum cold hydraulic to | est pressure of | 150 bar g | 2176 psi g |

Capacities

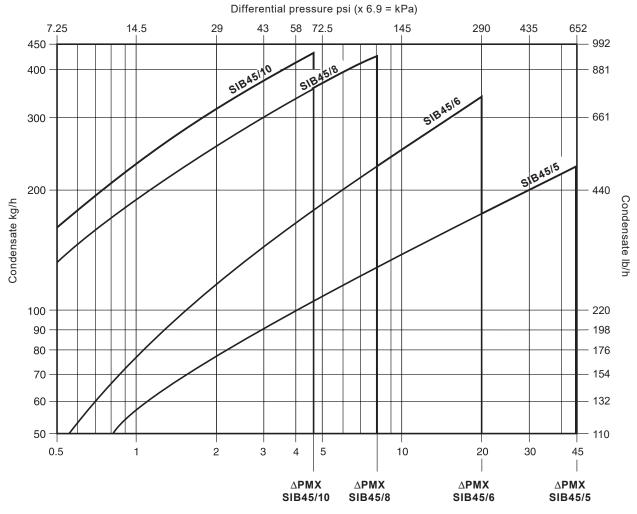


Differential pressure bar (x 100 = kPa)

Note: A trap should be selected for the most appropriate working pressure differential and not on the basis of load, e.g.: 80 kg/h at 7 bar (176 lb/h at 102 psi) at 7 bar differential should be handled with the SIB45/8 and not the SIB45/5.

TI-P110-02

CMGT Issue 9

Dimensions / weights (approximate) in mm (inches) and kg (Ibs)

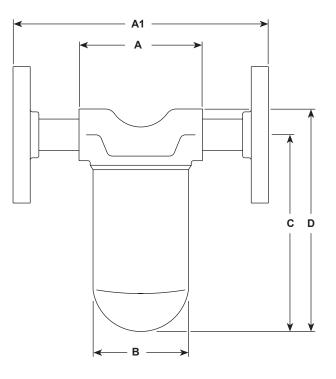

| | | | | | | Weight | |
|------------------------|---------------|---------------|--------------|---------------|---------------|-------------|---------------|
| Size | Α | A1 | В | С | D | SW/BW | Flanged |
| DN20 - ¾" DN25 - 1" | 110 (4.33) | 230 (9.06) | 85 (3.35) | 175 (6.89) | 198 (7.80) | 3 (6.61) | 6.5 (14.3) |

Safety information, installation and maintenance

For full details see the Installation and Maintenance Instructions (IM-P110-05) supplied with the product.

Installation

Install in a horizontal pipe, below the drain point. If installed in exposed positions, consideration should be given to insulating the trap.

How to order

Example: 1 off Spirax Sarco DN20 SIB45/5 sealed inverted bucket steam trap flanged to ANSI 600.

Note: The cover (and flanges when specified) are welded to the body using the TIG process. Welds are approved in accordance with ASME section IX and BS 4870, Part 1.