

**Single and Double Window Sight Glasses
and Sight Check**
Installation and Maintenance Instructions

**Single window
sight glass****Double window
sight glass****SG13
sight glass****SG253
sight glass****Sight check**

- 1. Safety information*
- 2. General product information*
- 3. Installation*
- 4. Commissioning*
- 5. Operation*
- 6. Maintenance and Spare parts*



1. Safety information

Safe operation of these products can only be guaranteed if they are properly installed, commissioned, used and maintained by qualified personnel (see Section 1.11) in compliance with the operating instructions. General installation and safety instructions for pipeline and plant construction, as well as the proper use of tools and safety equipment must also be complied with.

Warning

The gaskets used in these units (with exception to the SG13) contain thin stainless steel support rings which may cause physical injury if not handled and disposed of carefully.

Under certain conditions corrosive elements in condensate can affect the inside face of the sight tube/window, particularly where caustic alkali and hydrofluoric acid are present. It is recommended that the sight glass/sight check is periodically checked for thinning of the sight tube/window. If there is evidence of thinning or erosion damage then the sight tube/window should be replaced immediately. Always wear eye protection when viewing the contents of the sight glass/sight check.

Reasonable steps should be taken to protect personnel from injury in the unlikely event that the sight tube/window breaks.

1.1 Intended use

Referring to the Installation and Maintenance Instructions, name-plate and Technical Information Sheet, check that the product is suitable for the intended use/application.

- i) The products use on other fluids may be possible but, if this is contemplated, Spirax Sarco should be contacted to confirm the suitability of the product for the application being considered.
- ii) Check material suitability, pressure and temperature and their maximum and minimum values. If the maximum operating limits of the product are lower than those of the system in which it is being fitted, or if malfunction of the product could result in a dangerous overpressure or overtemperature occurrence, ensure a safety device is included in the system to prevent such over-limit situations.
- iii) Determine the correct installation situation and direction of fluid flow.

-
- iv) Spirax Sarco products are not intended to withstand external stresses that may be induced by any system to which they are fitted. It is the responsibility of the installer to consider these stresses and take adequate precautions to minimise them.
 - v) Remove protection covers from all connections and protective film from all name-plates, where appropriate, before installation on steam or other high temperature applications.

1.2 Access

Ensure safe access and if necessary a safe working platform (suitably guarded) before attempting to work on the product. Arrange suitable lifting gear if required.

1.3 Lighting

Ensure adequate lighting, particularly where detailed or intricate work is required.

1.4 Hazardous liquids or gases in the pipeline

Consider what is in the pipeline or what may have been in the pipeline at some previous time. Consider: flammable materials, substances hazardous to health, extremes of temperature.

1.5 Hazardous environment around the product

Consider: explosion risk areas, lack of oxygen (e.g. tanks, pits), dangerous gases, extremes of temperature, hot surfaces, fire hazard (e.g. during welding), excessive noise, moving machinery.

1.6 Isolation

Consider the effect on the complete system of the work proposed. Will any proposed action (e.g. closing isolation valves, electrical isolation) put any other part of the system or any personnel at risk?

Dangers might include isolation of vents or protective devices or the rendering ineffective of controls or alarms. Ensure isolation valves are turned on and off in a gradual way to avoid system shocks.

1.7 Pressure

Before attempting any maintenance consider what is or may have been in the pipeline. Ensure that any pressure is isolated and safely vented to atmospheric pressure before attempting to maintain the product, this is easily achieved by fitting Spirax Sarco depressurisation valves type DV (see separate literature for details) and consider double isolation (double block and bleed) and the locking or labelling of closed valves. Do not assume that the system is depressurised even when a pressure gauge indicates zero.

1.8 Temperature

Allow time for temperature to normalise after isolation to avoid the danger of burns and consider whether protective clothing (including safety glasses) is required.

PTFE (SG13 - sight tube gasket):

If parts made from PTFE have been subjected to a temperature approaching 260°C (500°F) or higher, they will give off toxic fumes, which if inhaled are likely to cause temporary discomfort. It is essential for a no smoking rule to be enforced in all areas where PTFE is stored, handled or processed as persons inhaling the fumes from burning tobacco contaminated with PTFE particles can develop 'polymer fume fever'.

1.9 Tools and consumables

Before starting work ensure that you have suitable tools and/or consumables available. Use only genuine Spirax Sarco replacement parts.

1.10 Protective clothing

Consider whether you and/or others in the vicinity require any protective clothing to protect against the hazards of, for example, chemicals, high/low temperature, radiation, noise, falling objects, and dangers to eyes and face.

1.11 Permits to work

All work must be carried out or be supervised by a suitably competent person. Installation and operating personnel should be trained in the correct use of the product according to the Installation and Maintenance Instructions.

Where a formal 'permit to work' system is in force it must be complied with. Where there is no such system, it is recommended that a responsible person should know what work is going on and, where necessary, arrange to have an assistant whose primary responsibility is safety.

Post 'warning notices' if necessary.

1.12 Handling

Manual handling of large and/or heavy products may present a risk of injury. Lifting, pushing, pulling, carrying or supporting a load by bodily force can cause injury particularly to the back. You are advised to assess the risks taking into account the task, the individual, the load and the working environment and use the appropriate handling method depending on the circumstances of the work being done.

1.13 Residual hazards

In normal use the external surface of the product may be very hot. If used at the maximum permitted operating conditions the surface temperature of some products may reach temperatures of 100°C (212°F).

Many products are not self-draining. Take due care when dismantling or removing the product from an installation (refer to 'Maintenance instructions').

1.14 Freezing

Provision must be made to protect products which are not self-draining against frost damage in environments where they may be exposed to temperatures below freezing point.

1.15 Disposal

Unless otherwise stated in the Installation and Maintenance Instructions, these products are recyclable and no ecological hazard is anticipated with their disposal providing due care is taken, except:

PTFE (SG13 - sight tube gasket):

- Waste parts can only be disposed of by approved methods, not incineration.
- Keep PTFE waste in a separate container, do not mix it with other rubbish, and consign it to a landfill site.

1.16 Returning products

Customers and stockists are reminded that under EC Health, Safety and Environment Law, when returning products to Spirax Sarco they must provide information on any hazards and the precautions to be taken due to contamination residues or mechanical damage which may present a health, safety or environmental risk. This information must be provided in writing including Health and Safety data sheets relating to any substances identified as hazardous or potentially hazardous.

— 2. General product information —

2.1 Single window and double window sight glasses

General description

A range of single and double window sight glasses having screwed connections available in either brass or bronze depending on size.

Note: For additional information see the following Technical Information Sheet TI-P022-05.



Fig. 1
Single window sight glass




Fig. 2
Double window sight glass

Sizes and pipe connections

Single window 3/8", 1/2", 3/4" and 1" screwed BSP or NPT

Double window 1/2", 3/4", 1" 1 1/2" and 2" screwed BSP or NPT

Pressure / temperature limits

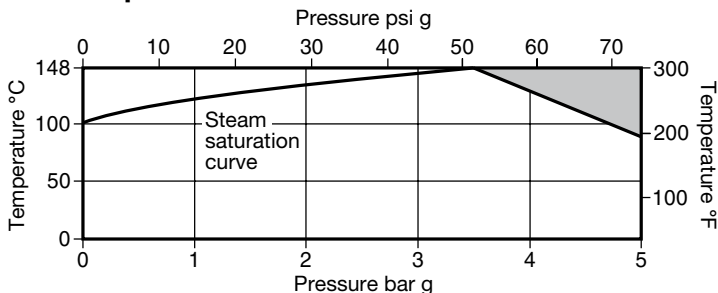

The product **must not** be used in this region.

Body design conditions	PN5	
PMA Maximum allowable pressure	5 bar g @ 90°C	(72.5 psi g @ 194°F)
TMA Maximum allowable temperature	148°C @ 3.5 bar g	(298.4°F @ 50.75 psi g)
Minimum allowable temperature	-29°C (-20.2°F)	
PMO Maximum operating pressure for saturated steam service	3.5 bar g	(50.75 psi g)
TMO Maximum operating temperature	148°C @ 3.5 bar g	(298.4°F @ 50.75 psi g)
Minimum operating temperature	0°C (32°F)	
Note: For lower temperatures consult Spirax Sarco.		
Designed for a maximum cold hydraulic test pressure of:	7 bar g	(101.5 psi g)
PTMX Maximum test pressure (steam service)	3.5 bar g	(50.75 psi g)

2.2 SG13 sight glass

General description

The SG13 is a maintainable brass multi-window sight glass with a cylindrical viewing window and screwed connections. The sight glass monitors the discharge downstream of steam traps in pressurised condensate return lines. It is screwed directly into the steam trap providing a modular monitoring system, thus eliminating the need for a connecting nipple, minimising joints and potential leak paths.

The sight glass can also be installed in process lines to provide a visual indication of flow.

Note: For additional information see the following Technical Information Sheet TI-P130-11.




Fig. 3
SG13 sight glass

Sizes and pipe connections

½", ¾" and 1" screwed BSP male taper/female parallel to BS 21 or

½", ¾" and 1" screwed NPT male/female to ASME (ANSI) B 1.20.1.

Pressure / temperature limits

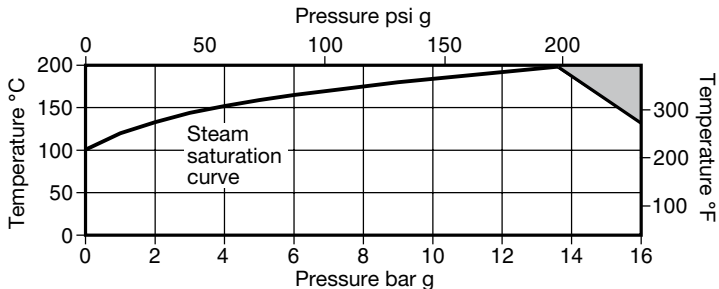

 The product **must not** be used in this region.

Body design conditions	PN16	
PMA Maximum allowable pressure	16 bar g @ 130°C	(232 psi g @ 266°F)
TMA Maximum allowable temperature	200°C @ 13.5 bar g	(392°F @ 195.8 psi g)
Minimum allowable temperature	-20°C (-4°F)	
PMO Maximum operating pressure for saturated steam service	13 bar g	(188.5 psi g)
TMO Maximum operating temperature	200°C @ 13.5 bar g	(392°F @ 195.8 psi g)
Minimum operating temperature	0°C (32°F)	
Note: For lower temperatures consult Spirax Sarco.		
Designed for a maximum cold hydraulic test pressure of:	24 bar g	(348 psi g)
PTMX Maximum test pressure (steam service)	13 bar g	(188.5 psi g)

2.3 SG253 sight glass

General description

The SG253 is an SG iron double window sight glass with flanged connections.

Note: For additional information see the following Technical Information Sheet TI-P130-01IN.




Fig. 4
SG253 sight glass

Sizes and pipe connections

DN15, DN20, DN25, DN32, DN40 and DN50.

Flanged EN 1092 PN25 and BS 1560 ASME (ANSI) B 1.20.1.

Pressure / temperature limits

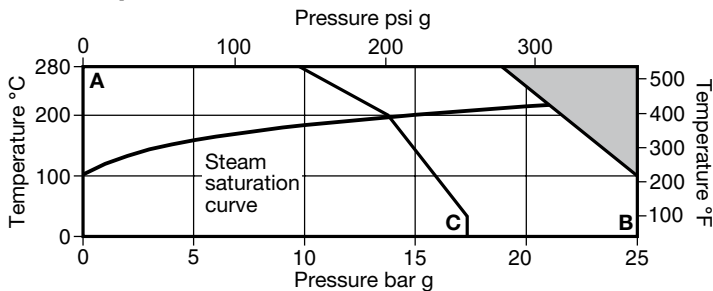

 The product **must not** be used in this region.

A - B Flanged EN 1092 PN25.

A - C Flanged BS 1560 ASME (ANSI) Class 150.

Body design conditions		PN25 and ASME (ANSI) 150	
PMA	Maximum allowable pressure	PN25	25 bar g @ 100°C (362.5 psi g @ 212°F)
		ASME 150	17.2 bar g @ 35°C (249.5 psi g @ 95°F)
TMA	Maximum allowable temperature	PN25	280°C @ 18 bar g (536°F @ 261 psi g)
		ASME 150	280°C @ 10 bar g (536°F @ 145 psi g)
Minimum allowable temperature			-10°C (14°F)
PMO	Maximum operating pressure for saturated steam service	PN25	21 bar g (304.5 psi g)
		ASME 150	13.8 bar g (200.1 psi g)
TMO		Maximum operating temperature	280°C @ 18 bar g (536°F @ 261 psi g)
Minimum operating temperature			0°C (32°F)
Note: For lower temperatures consult Spirax Sarco.			
Designed for a maximum cold hydraulic test pressure of:		PN25	38 bar g (551 psi g)
		ASME 150	25.8 bar g (374 psi g)
PTMX	Maximum test pressure (steam service)	PN25	21 bar g (304.5 psi g)
		ASME 150	13.8 bar g (200.1 psi g)

2.4 Sight check

General description

A sight check is a combined sight glass and check valve. It is used to observe discharges from steam traps. The position of the ball check indicates whether or not condensate is flowing. Where condensate rises after the trap it eliminates the need for a separate check valve thus simplifying installation.

It is particularly useful for commissioning steam traps fitted with a steam lock release (SLR) unit. It can also be used on other liquid lines where the materials of construction are compatible.

Note: For additional information see the following Technical Information Sheet TI-P022-01.

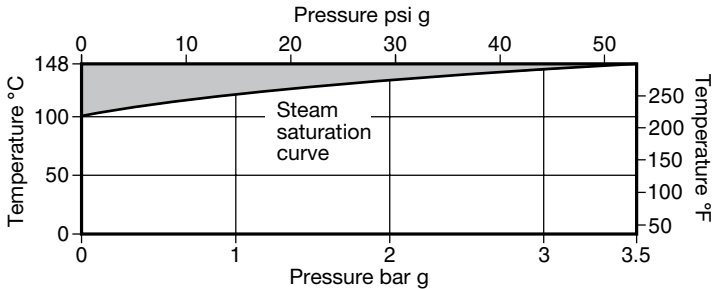


Fig. 5
Sight check

Sizes and pipe connections

½", ¾" and 1" screwed BSP or NPT.

Pressure / temperature limits



 The product **must not** be used in this region.

Body design conditions	PN3.6	
PMA Maximum allowable pressure	3.5 bar g @ 148°C	(50.75 psi g @ 295.6°F)
TMA Maximum allowable temperature	148°C @ 3.5 bar g	(294.8°F 50.25 psi g)
Minimum allowable temperature	-10°C (14°F)	
PMO Maximum operating pressure for saturated steam service	3.5 bar g	(50.75 psi g)
TMO Maximum operating temperature	148°C 3.5 bar g	(295.6°F @ 50.75 psi g)
Minimum operating temperature	0°C (32°F)	
Note: For lower temperatures consult Spirax Sarco.		
Designed for a maximum cold hydraulic test pressure of:	7 bar g	(101.5 psi g)
PTMX Maximum test pressure (steam service)	3.5 bar g	(50.75 psi g)

3. Installation

Note:

Before actioning any installation observe the 'Safety information' in Section 1.

Warning

Under certain conditions corrosive elements in condensate can affect the inside face of the sight tube/window, particularly where caustic alkali and hydrofluoric acid are present. It is recommended that the sight glass/sight check is periodically checked for thinning of the sight tube/window. If there is evidence of thinning or erosion damage then the sight tube/window should be replaced immediately. Always wear eye protection when viewing the contents of the sight glass/sight check.

Reasonable steps should be taken to protect personnel from injury in the unlikely event that the sight tube/window breaks.

Sight glasses and sight checks can be fitted in either a horizontal or vertical line (flow upwards only for sight check) on the outlet side of a steam trap. Where the trap is a blast discharge type e.g. thermodynamic, the sight glass and sight check must be fitted at least 1 m (3 ft) from the trap. This is to ensure that the glass is not subjected to thermal shock or pressure. Reasonable steps should be taken to protect personnel from injury in the unlikely event that the glass breaks.

Ensure access is available for maintenance purposes.

4. Commissioning

After installation or maintenance ensure that the system is fully functional. Carry out tests on any alarms or protective devices.

5. Operation

5.1 Sight glasses

The sight glass has a smooth concentric reduction in the inlet connection which promotes turbulence in the sight glass when the fluid is passing through it. The turbulent flow inside the sight glass permits any fluid to be detected.

Sight glasses can be used to detect blocked valves, strainers, steam traps and other pipeline equipment. Sight glasses can also be used for inspection purposes, i.e. to compare the colour of the fluid at different stages of the process, enabling adjustments to be made quickly and effectively.

The SG13 cylinder view can be screwed directly into the steam trap it is monitoring to form a modular steam trap arrangement.

5.2 Sight checks

The sight check is a sight glass and check valve combination in one unit. A ball in the top of the flow tube is lifted off its seat by the fluid as it flows through the cylindrical window to the outlet connection. The ball movement makes the flow easy to see yet provides shut-off on reverse flow.

— 6. Maintenance and Spare parts —

6.1 Single window and double window sight glasses

Note:

Before actioning any maintenance programme observe the 'Safety information' in Section 1.

How to renew the window(s) and gaskets:

- Isolate the sight glass and allow the pressure and temperature to reduce to ambient conditions.
- After isolation unscrew the bezel(s) (2) and remove old gaskets (4 and 5) and window(s) (3).
- Carefully clean the recess.
- Refit new gaskets and window(s), ensuring that a gasket (4) is fitted to either side of each window (3).
- Replace the bezel(s) and tighten to the recommended torque (see Table 1).
- After maintenance has been completed, isolation valves should be opened slowly to allow pressure and temperature to build up in a controlled manner.
- Check for leaks.

6.2 Spare parts (for the single window and double window sight glasses)

The spare parts available are shown in solid outline. Parts drawn in broken line are not supplied as spares.

Available spares

Set of windows and gaskets	3, 4, 5
Set of gaskets	4, 5

How to order spares

Always order spares by using the description given in the column headed 'Available spares' and state the size and type of sight glass.

Example: 1 off Set of windows and gaskets for a Spirax Sarco 1" double window sight glass.

Fig. 6
Single window
sight glass

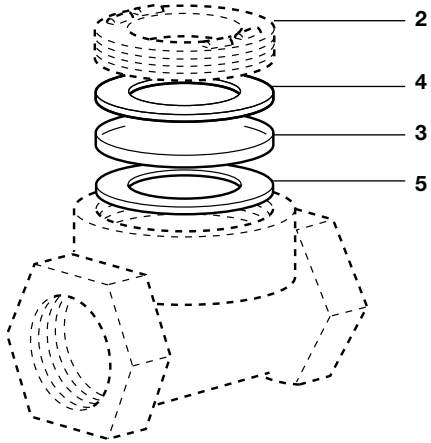


Fig. 7
Double window
sight glass

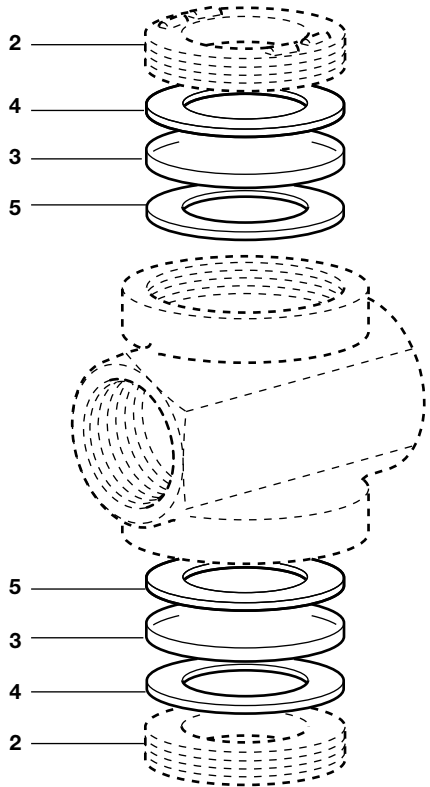




Table 1 Recommended tightening torque

Item No.	Part	 or  mm	N m	(lbf ft)
2	Bezel		60 - 65	(43 - 47)

6.3 SG253 sight glass

Note:

Before actioning any maintenance programme observe the 'Safety information' in Section 1.

How to renew the windows and gaskets:

- Isolate the sight glass and allow the pressure and temperature to reduce to ambient conditions.
- After isolation unscrew the cover bolts (5) and remove the old gaskets (4) and windows (3).
- Carefully clean the recess.
- Refit new gaskets and windows, ensuring that a gasket (4) is fitted to either side of each window (3).
- Replace the covers (2) and cover bolts (5) and tighten to the recommended torque (see Table 2).
- After maintenance has been completed, isolation valves should be opened slowly to allow pressure and temperature to build up in a controlled manner.
- Check for leaks.

6.4 Spare parts (for the SG253 sight glass)

The spare parts available are shown in solid outline. Parts drawn in broken line are not supplied as spares.

Available spares

Set of windows and gaskets	3, 4
----------------------------	-------------

Please note: For the DN25 and DN32 sizes a set of bolts (16 A/F M10 x 40) is also included due to the increased thickness of the glass.


Set of gaskets	4
----------------	----------

How to order spares



Always order spares by using the description given in the column headed 'Available spares' and state the size and type of the sight glass.

Example: 1 off Set of windows and gaskets for a Spirax Sarco DN15 SG253 sight glass.

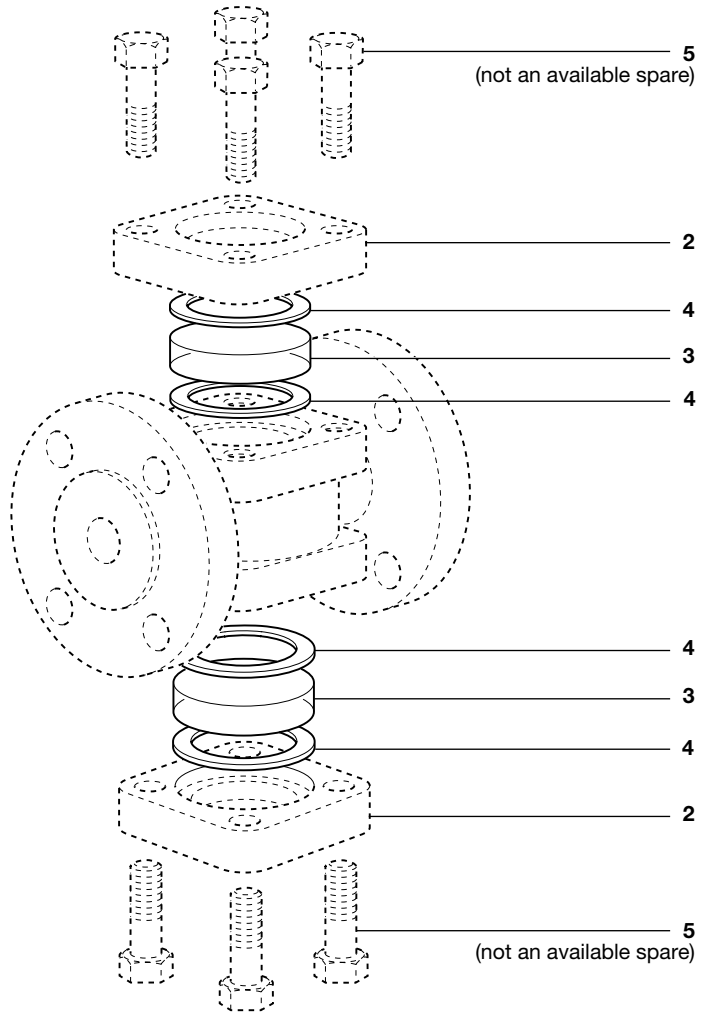Fig. 8
SG253 sight glass



Recommended tightening torques

Item	Part	or		N m	(lbf ft)
					
5	DN15 - DN20	17 A/F	M10 x 30	12	(8.6)
	DN25 - DN32	Pre 08-2010:	17 A/F M10 x 35	28	(20.6)
		Post 08-2010:	16 A/F M10 x 40		
DN40 - DN50	19 A/F	M12 x 40	38	(28.0)	

6.5 SG13 sight glass

Note:

Before actioning any maintenance programme observe the 'Safety information' in Section 1.

How to renew the sight tube and gaskets:

- Isolate the sight glass and allow the pressure and temperature to reduce to ambient conditions.
- After isolation remove the SG13 sight glass from the pipeline.
- Unscrew the end connection from the body (2) and remove the sight tube (4).
- Take out the old gaskets (3) taking care not to damage the seating face and carefully clean out the recesses.
- Fit the new gaskets (3) supplied with sight tube (4) (see Section 6.6, Spare parts).
- Ensure the sight tube (4) is aligned correctly within the body. Then tighten the end connection (2) to the recommended torque (see Table 3). **Note:** Misalignment of the sight tube (4) within the body may cause the edge of the glass to fracture.
- Refit the sight glass into the pipeline.
- After maintenance has been completed, isolation valves should be opened slowly to allow pressure and temperature to build up in a controlled manner.
- Check for leaks.

6.6 Spare parts (for the SG13 sight glass)

The spare parts available are shown in solid outline. Parts drawn in broken line are not supplied as spares.

Available spare

Sight glass assembly	3 (2 off), 4
----------------------	--------------

How to order spares

Always order spares by using the description given in the column headed 'Available spare'. Since the sight glass assembly is the same for all three sizes, it will always be:-

Example: 1 off Sight glass assembly for a Spirax Sarco SG13 sight glass.

Fig. 9
SG13 sight glass

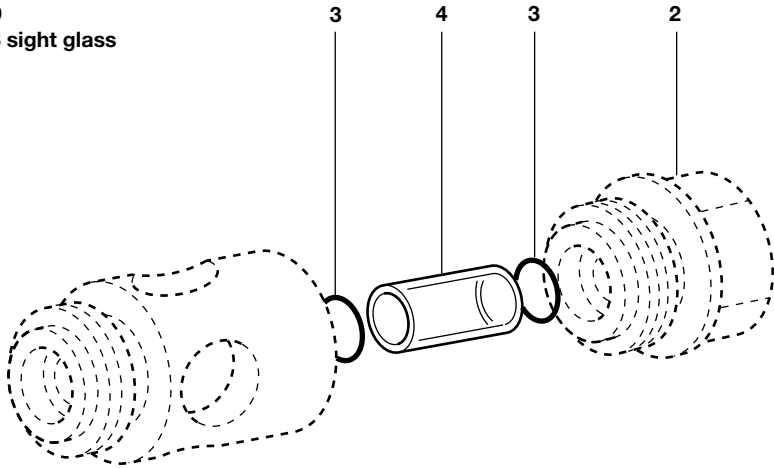




Table 3 Recommended tightening torques

Item No.	Part	 or  mm	N m	(lbf ft)
2	1/2" - DN15	32 A/F	35 - 40	(25 - 29)
	3/4" - DN20	36 A/F	35 - 40	(25 - 29)
	1" - DN25	46 A/F	35 - 40	(25 - 29)

6.7 Sight check

Note:

Before actioning any maintenance programme observe the 'Safety information' in Section 1.

How to renew the sight tube:

- Isolate the sight check and allow the pressure and temperature to reduce to ambient conditions.
- After isolation remove the bolt and washers (7 and 8).
- Remove the cover (6).
- Take out the old gaskets (2) and the sight tube (3) and carefully clean out the recesses.
- Fit the new gaskets (2) supplied with sight tube (3) and reassemble. Tighten the bolts evenly to the recommended torque, ensuring the ends of the sight tube are centralised on the gaskets (see Table 4).
- It is advisable to do up the bolts little more than finger tight, retightening as necessary after a period of use to the recommended tightening torque (see Table 4).
- After maintenance has been completed, isolation valves should be opened slowly to allow pressure and temperature to build up in a controlled manner.
- Check for leaks.

How to renew the discharge tube:

- Remove the cover (6) and the sight tube (3) the same way as 'To renew sight tube' above, and lift out the ball check (5).
- Using the notches, carefully unscrew the old discharge tube (4) and fit a new one.
- Renew the gaskets (2), fit a new ball check (5) and reassemble. Tighten the bolts evenly to the recommended torque, ensuring the ends of the sight tube are centralised on the gaskets (see Table 4).
- After maintenance has been completed, isolation valves should be opened slowly to allow pressure and temperature to build up in a controlled manner.
- Check for leaks.

6.8 Spare parts (for the sight check)

The spare parts available are shown in solid outline. Parts drawn in broken line are not supplied as spares.

Available spares

Sight tube assembly	2 (2 off), 3 (1 off)
Discharge tube assembly (set of 2)	4, 5
Set of bolts and washers (set of 4*)	7, 8
Gasket set (packet of 6†)	2

Available spares are common to ½" and ¾" sizes, but not 1".

Note:

- * Earlier models used studs, nuts and washers and these are contained in the set of bolts pack.
- † Earlier models used ethylene propylene gaskets which were considerably thicker than graphite laminate.

How to order spares

Always order spares by using the description given in the column headed 'Available spares' and state the size of the sight check.

Example: 1 off Sight tube assembly for a Spirax Sarco ½" sight check.

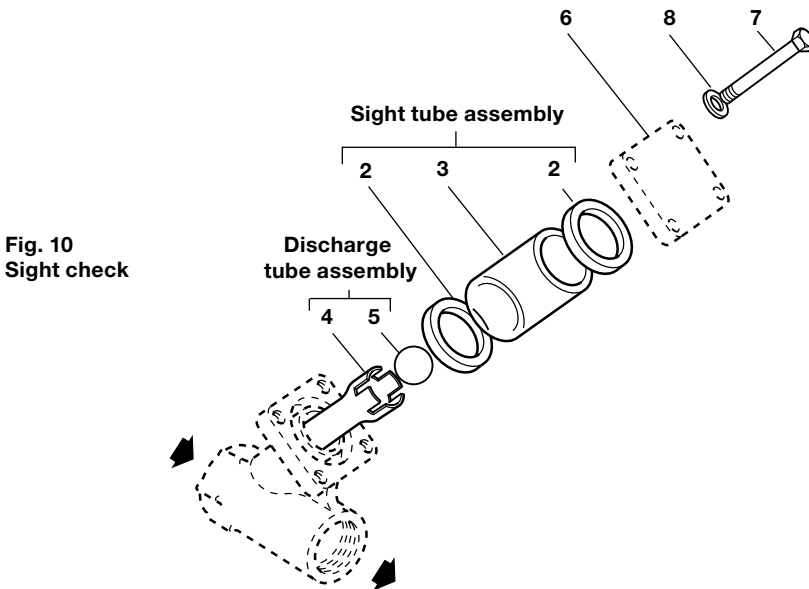




Fig. 10
Sight check

Table 4 Recommended tightening torques

Item No.	Part	 or  mm	N m	(lbf ft)
7	½", ¾" and 1"	10 A/F M6 x 65	1.8 - 2.2	(1.3 - 1.6)
4	½" and ¼"	9/16" x 26 BSW	5 - 6	(3.6 - 4.3)
	1"	7/8" x 20 UNF	5 - 6	(3.6 - 4.3)

