

BT1050 Boiler Blowdown Timer

Description

The BT1050 is a timer for the control of a bottom blowdown valve. It allows the bottom blowdown valve to open, removing precipitated solids that could otherwise build up and eventually cause damage.

The BT1050 has three timers. These allow different blowdown cycle times and durations to be set, for example, MON - FRI. Up to three blowdown cycles can be selected in one day. The timers can also be used to prioritise boiler blowdown cycles.

The product can be panel, DIN rail or chassis mounted and is powered by a 110 to 240 Vac at 50/60 Hz mains supply.

The front panel has an LCD graphic display and five-button keypad.

A test function provides the operator with a diagnostic tool.

The BT1050 can communicate via an infrared link between adjacent units. It can be designated as either a slave or a master unit, and connected to a two or four wire EIA/TIA-485 multi-drop network.

Up to nine BT1050 (or BT1000) units can be installed and linked for multi-boiler installations.

Approvals

The BT1050 complies with Electromagnetic Compatibility Directive 2004/108/EC and all its requirements.


This product is suitable for Class A environments (e.g. industrial). A fully detailed EMC assessment has been made and has the reference number UK Supply BH BT1050 2008.

The BT1050 complies with the Low Voltage Directive (2006/95/EC) by meeting the standards of:

- EN 61010-1:2010 safety requirements for electrical equipment for measurement, control, and laboratory use.
- UL listed (open)

Principal features:

- Purpose designed for bottom blowdown duties.
- Three separately adjustable timers.
- Straightforward to commission – quick set-up option.
- Universal power supply - 110 Vac to 240 Vac.
- Timers prevent boilers from blowing down in rapid succession.
- Warns if valve fails to open or close.
- UL approved

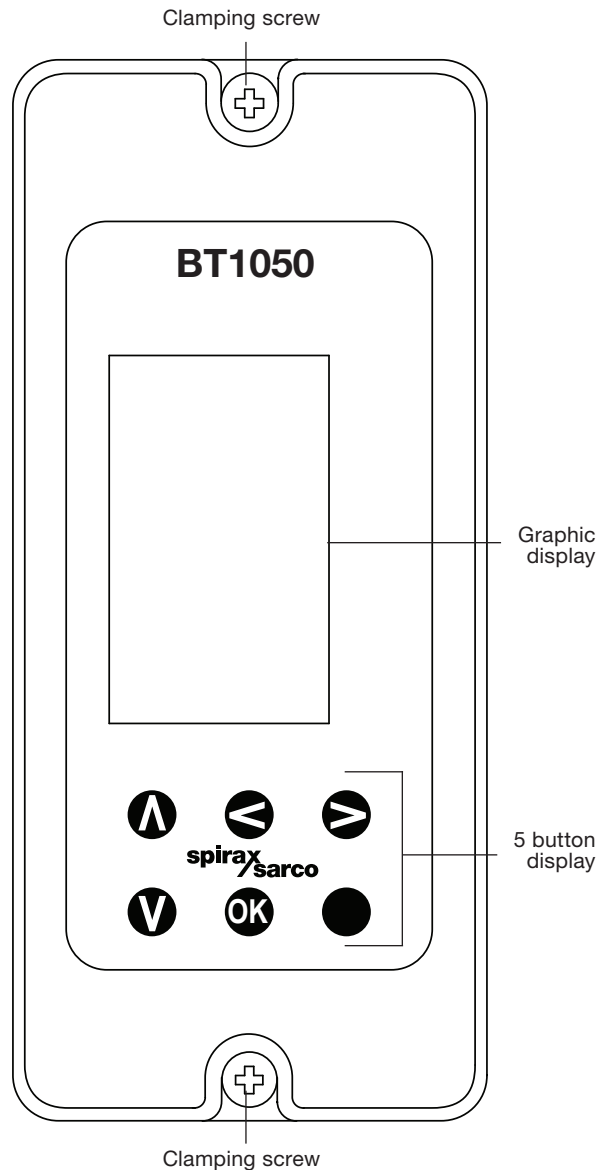

BT1050

Boiler Blowdown Timer

Technical data BT1050

Power supply	Mains voltage range	110 Vac to 240 Vac at 50/60 Hz			
	Power consumption	7.5 W (maximum)			
Environmental	General	Indoor use only			
	Maximum altitude	2 000 m (6 562 ft) above sea level			
	Ambient temperature limits	0 - 55°C (32-131°F)			
	Maximum relative humidity	80% up to 31°C (88°F) decreasing linearly to 50% at 40°C (104°F)			
	Overvoltage category	III			
	Pollution degree	2 (as supplied)			
		3 (when installed in an enclosure) - Minimum of IP54 or UL50 / NEMA Type 3, 3S, 4, 4X, 6, 6P or 13.			
	Enclosure rating (front panel only)	NEMA type 4 hose down only (UL approval) and IP65 (verified by TRAC Global)			
	LVD (safety)	Electrical safety EN 61010-1 UL61010-1, 3rd Edition, 2012-05 CAN/CSA-C22.2 No. 61010-1, 3rd Edition, 2012-05			
	EMC	Immunity	EN 61326: A1 + A2 Annex A Table 1 for industrial locations		
		Emissions	EN 61326: A1 + A2 Class A Table 4		
Enclosure	Material	Polycarbonate			
Front panel	Material	Silicone rubber, 60 shore.			
Solder	Tin/lead (60/40%)				
Mains and signal connector	Termination	Rising clamp plug-in terminal blocks with screw connectors. Caution: Use only the connectors supplied by Spirax Sarco Ltd. Safety and Approvals may be compromised otherwise.			
	Cable size	0.2 mm ² (24 AWG) to 2.5 mm ² (12 AWG).			
	Stripping length	5 - 6 mm (0.2")			
Cable / wire and connector data	Switch box and Lockout (link) circuit	Type	High temperature		
		Shield type	Screened		
		Number of cores	2		
		Gauge	1 - 1.5 mm ² (18 - 16 AWG)		
		Maximum length	100 m (328 ft)		
		Recommended type	Prysmian (Pirelli) FP200, Delta Crompton Firetuf OHLS		
	RS485 communication	Type	EIA RS485 twisted pair		
		Shield type	Screened		
		Number of pairs	2 or 3		
		Gauge	0.23 mm ² (24 AWG)		
		Maximum length	1200 m (4000 ft)		
		Recommended type	Alpha wire 6413 or 6414		
				Please note that LAN Cat 5 or Cat 5E ScTP (screened), FTP (foil) or STP (shielded) cable can be used, but limited to 600 m.	

BT1050

Boiler Blowdown Timer


Technical data BT1050 (continued)

Input	Switch box	Maximum voltage	32 Vdc (no load, open circuit)		
		Maximum current	3 mAdc (short circuit)		
	Lockout (link)	Maximum voltage	32 Vdc (no load, open circuit)		
		Maximum pulldown voltage	0.25 Vdc		
		Maximum current	1.5 mAdc		
RS485	Physical layer	RS485 4-wire full or 2-wire half duplex			
	Protocol	Modbus RTU format			
	Isolation	60 Vac/dc			
	Receiver unit load	1/8 (256 devices - maximum)			
	Output rate	Up to 10 frames / second			
Clock calendar battery	Type	AA (PCB tagged) Lithium Thionyl Chloride (Lithium content 0.65g)			
	Shelf life	10 year – with battery switch off @ TAMB: 25°C (77°F)			
	Working life	10 year – Mains power on 35 hours/week @ TAMB: 55°C (131°F)			
Infrared	Physical layer	IrDA			
	Baud	38400			
	Range	10 cm (4")			
	Working angle	15°			
	Eye safety information	Exempt from EN 60825-12: 2007 Safety of laser products ~ does not exceed the accessible emission limits (AEL) of class 1			
Output	Relays	Contacts	2 x single pole changeover relays (SPCO)		
		Voltage ratings (maximum)	250 Vac		
		Load	Resistive	3 amp @ 250 Vac	
			Inductive	1 amp @ 250 Vac	
		ac motor load	1/4 HP (2.9 amp) @ 250 Vac		
			1/10 HP (3 amp) @ 120 Vac		
		Pilot duty load	C300 (2.5 amp) - control circuit/coils		
		Electrical life (operations)	3 x 10 ⁵ or greater depending on load		
		Mechanical life (operations)	30 x 10 ⁶		

BT1050 Boiler Blowdown Timer

Dimensions/weight (approximate)

Weight (0.9 lb)

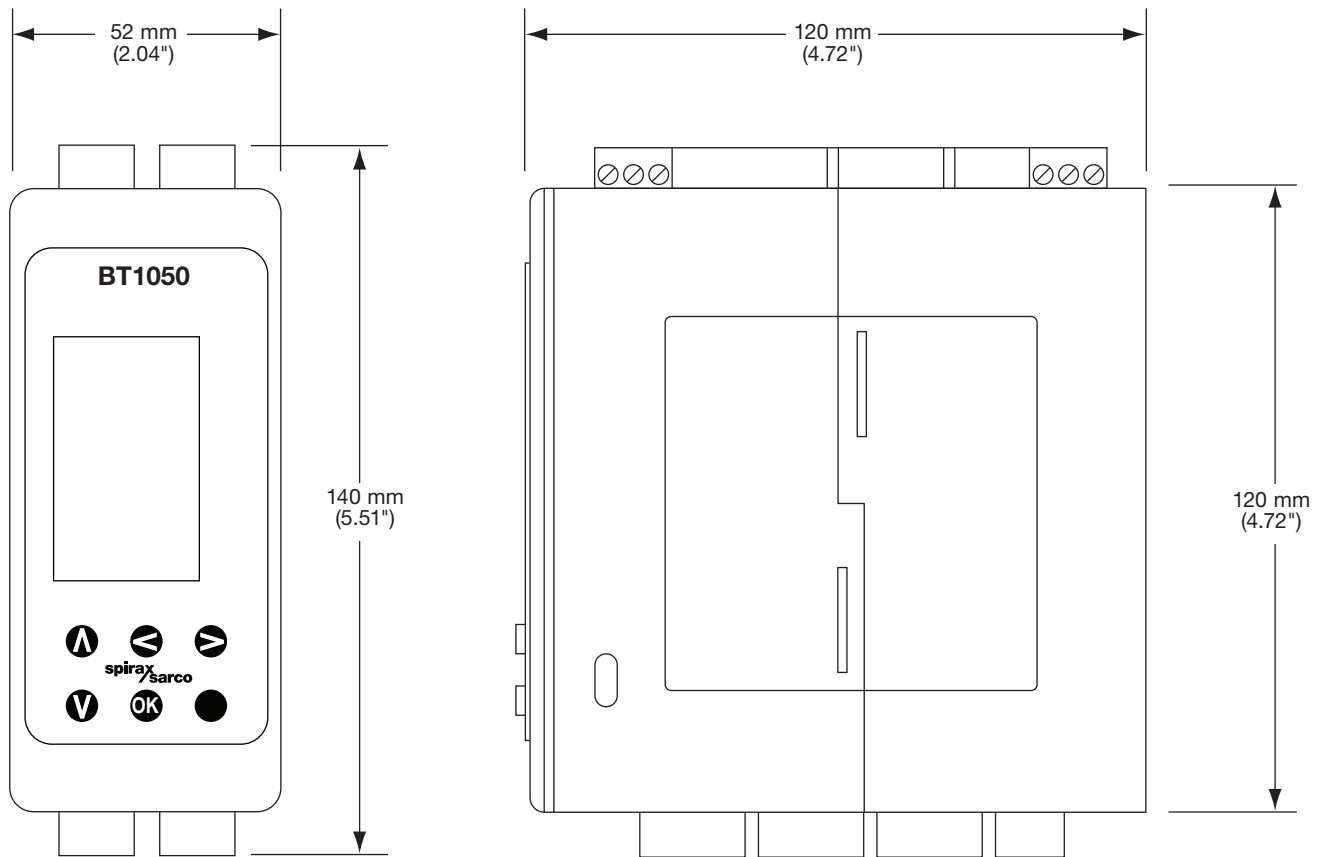

Safety information, installation and maintenance

This document does not contain sufficient information to install the product safely. See the Installation and Maintenance Instructions supplied with the product, which gives full wiring, commissioning and operating instructions.

Attention is drawn to Safety Information Leaflet IM-GCM-10, as well as to any national regulations concerning blowdown. In particular, your attention is drawn to the danger of working on a shut down boiler whilst other boilers are operating.

Warnings:

- Isolate the mains supply before installing the controller as live terminals at mains voltage are exposed.
- Only use the screws provided with the product.
- Do not install the product outdoors without additional weather protection.
- Do not drill the product case or use self-tapping screws.

Caution:

- A 15 mm (0.6") gap is required between multiple controllers for cooling.

Installation / environmental conditions:

Install the product in an environment that minimises the effects of heat, vibration, shock and electrical interference.

The product must be installed in a suitable industrial control panel or fireproof enclosure to provide impact and environmental protection.

A minimum of IP54 (EN 60529) or Type 3, 3S, 4, 4X, 6, 6P and 13 (UL50/NEMA 250) is required.

The product may be installed on a DIN rail, chassis plate, or in a panel cutout. A bezel is provided.

How to specify

Blowdown timer with; three integral timers, LCD display, valve malfunction alarm and infrared communications.

How to order

Example: 1 off Spirax Sarco BT1050 blowdown timer.